

Project for Community Development Block Grant

Applicant: City of Gas, Kansas
CDBG Environment assessment of improvements to water distribution system
CDBG Project No. 03-PF-302

Contact Person: Robert E. Hosack

Address: Hosack Community Planning and Development Services
209 East Tenth St.
Chanute, KS 66720

Phone: 316-431-9547

Sent to the Kansas Geological Survey for environmental review.

Agency Review Comments:

Any short-term adverse impacts during construction should be offset by the long-term benefits of the improvements to the water distribution system, including a decrease in a loss of supply water and better water quality after the old sand-cast iron and galvanized pipe are replaced with PCV lines.

Recommended Action:

- ☒ Clearance of project should be granted
- ☐ Clearance of project should not be granted
- ☐ Clearance of project should be delayed until the issues or questions have been clarified
- ☐ Clearance of project should not be delayed, but the applicant (in the application) should address or clarify the questions or concerns indicated above

Donald O. Whittemore
Reviewer's Name

Geohydrology Section, Kansas Geological Survey
Division/Agency

1/27/03
Date

Reviewer's Signature



Community Planning and Development Services

209 East Tenth Street — Chanute, Kansas 66720 — (316) 431-9547

January 17, 2003

Mr. Donald Whittemore, Senior Scientist
Kansas Geological Survey
The University of Kansas
1930 Constant Avenue, Campus West
Lawrence, Kansas 66047-3726

**Re: City of Gas, Kansas
CDBG Environmental Assessment
CDBG Project Number 03-PF-302**

Dear Mr. Whittemore:

The City of Gas, Kansas, located in Allen County, was recently awarded Community Development Block Grant (CDBG) funds to construct improvements to the City's water distribution system. As a part of the CDBG environmental review process, comments on this proposed project by your agency are hereby requested. In order for your agency's comments to be considered, they must be received in writing at the **letterhead address** above on or before **Friday, February 21, 2003**. If your agency does not respond by the specified date, it will be considered as a "no comment" on the project.


The proposed water distribution system improvements will consist of replacing deteriorated sand-cast iron and galvanized pipe with 10,650 linear feet of 8-inch PVC water mains; 20 fire hydrants; 600 linear feet of borings beneath U.S. 54 Highway; 2,960 linear feet of 1-inch PVC service lines; 400 linear feet of 2-inch PVC service lines; 14 connections to existing PVC water mains; and a connection to the City's elevated water storage tank. A project location map is enclosed for your review.

Technical information about this project may be obtained by contacting Rodney R. Young, P.E., Professional Engineering Consultants, P.A., Wichita, Kansas, at (316) 262-2691. If you should have any other questions, please do not hesitate to contact me at (620) 431-9547.

Sincerely,

Robert E. Hosack
CDBG Administrator

Enclosure

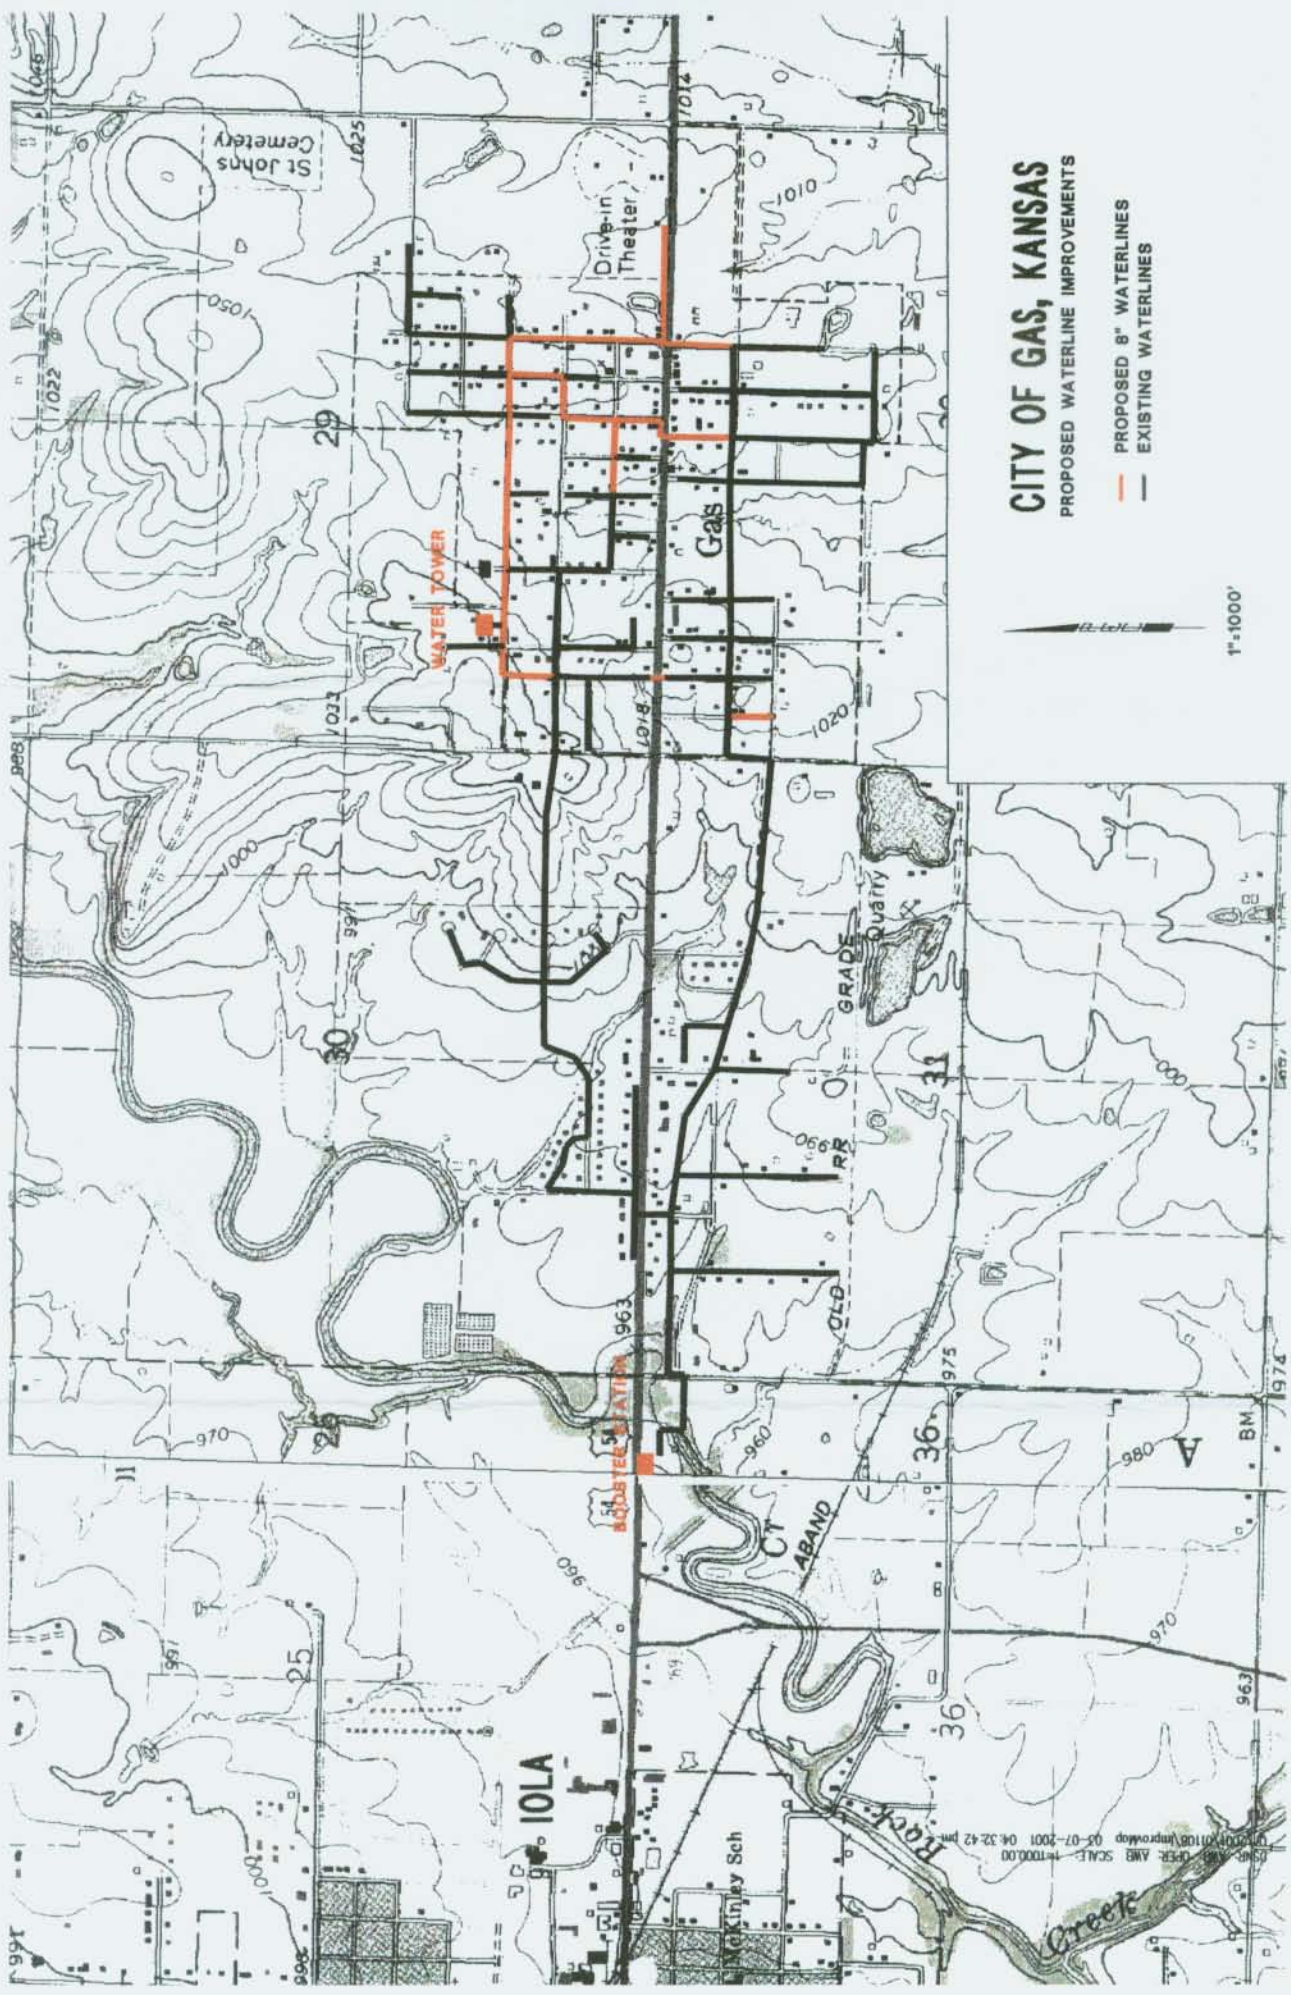

CITY OF GAS, KANSAS

PROPOSED WATERLINE IMPROVEMENTS

- PROPOSED 8" WATERLINES
- EXISTING WATERLINES



1"=1000'

05-07-2001 04:32:42
SCALE: 1"=1000.00
05-07-2001 04:32:42