

The following form may be used by the Review Agency/Commission for comments in response to the request for clearance from the proposed Public Water Supply Loan Fund Project.

☐	Army Corps of Engineers
☐	Kansas Biological Survey
☐	State Conservation Commission
☐	Kansas Corporation Commission
☒	Division of Water Resources/Kansas Department of Agriculture
☐	Kansas Geological Survey
☐	Kansas State Historical Society, State Historic Preservation Office
☐	Kansas Water Office
☐	Kansas Department of Wildlife & Parks
☐	US Dept of Agriculture - Natural Resources Conservation Service
☐	Kansas Department of Health and Environment
☐	US Dept of the Interior - Fish and Wildlife Service

Agency Review Comments: (to be completed by reviewing agency and returned to applicant contact person at name and address shown below)

Comments: The long-term benefits of the improvements to the
water distribution system should offset any short-term
adverse impacts during construction.

Recommended Action: (to be completed by the reviewing agency and returned to applicant contact person at name and address shown below.)

☒	Clearance of project should be granted
☐	Clearance of project should not be granted
☐	Clearance of project should be delayed until the issues or questions have been clarified.
☐	Clearance of project should not be delayed, but the applicant (in the application) should address or clarify the questions or concerns indicated above.)

Donald Whittemore

Reviewer's Name

KGS

Division/Agency/Commission

9/20/05

Date


Project Title: Public Water Supply Loan Fund Application

Applicant: Rural Water District #3 - Rooks Co

Contact Person: Ann Ochampough

Address: PO Box 382

City, State: Plainville, KS Zip: 67463 Phone: (785)-434-2273

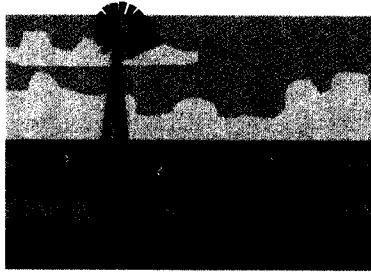

RURAL WATER DISTRICT #3

**Rooks County, Kansas
Box 382 - Plainville, KS 67663**

August 22, 2005

Kansas Geological Survey
University of Kansas
1930 Constant Ave., Campus West
Lawrence, KS 66047

Re: Rural Water District #3 - Rooks County
Kansas Public Water Supply Loan Fund
Project No. 2445

Gentlemen:

Rural Water District #3 is preparing an application to the Kansas Department of Health and Environment for a loan from the Kansas Public Water Supply Loan Fund for the referenced project.

Rooks County Rural Water District #3 operates two distinct water supply and distribution systems. The north system experiences low pressures due to undersized water lines and lack of a water storage facility. The south system experiences low pressures due to undersized lines and water supply wells that cannot meet peak flow demands. The purpose of the proposed project is to improve the low water pressures in the Rural Water District, improve the water distribution system, and to regionalize by connecting the two separate systems. Items of work include but are not limited to refurbishment of water wells, chlorination, and telemetry control systems; construction of a ground level water storage tank; installation of 4" and 6" water transmission lines and booster pumping station.

The existing wells are located in the NE 1/4 30-6-21, Graham County. The proposed water line will start at the well site and go east 13 1/2 miles meeting up with an existing line in the SE 1/4 21-6-19, Rooks County. This is along AA Rd in Graham County and E Rd in Rooks County. A water storage tank will be erected either in the NW 1/4 27-6-21 or SW 1/4 22-6-21, Graham County near the county road.


To the south, the existing lines will be joined by a 4" main beginning in the SE 1/4 19-7-20 or SW 1/4 20-7-20. This line will go 4 miles south along the 2 Rd to the NW 1/4 17-8-20. We will use directional boring to cross the Solomon River. All improvements will be in the county road right-a-way or existing easements. Options are being obtained for the storage tank and booster pump locations.

The total construction cost is projected to be \$1,081,800.00 plus non-construction costs of \$258,200 for a total project cost of \$1,340,000.

We would appreciate your review of the project description and location, and any comments you may have, within 30 days. A project review form is enclosed for your use.

Please call Ann Ochampaugh at 785-434-2273 if you have questions.

RVD #3
Rocks Co.

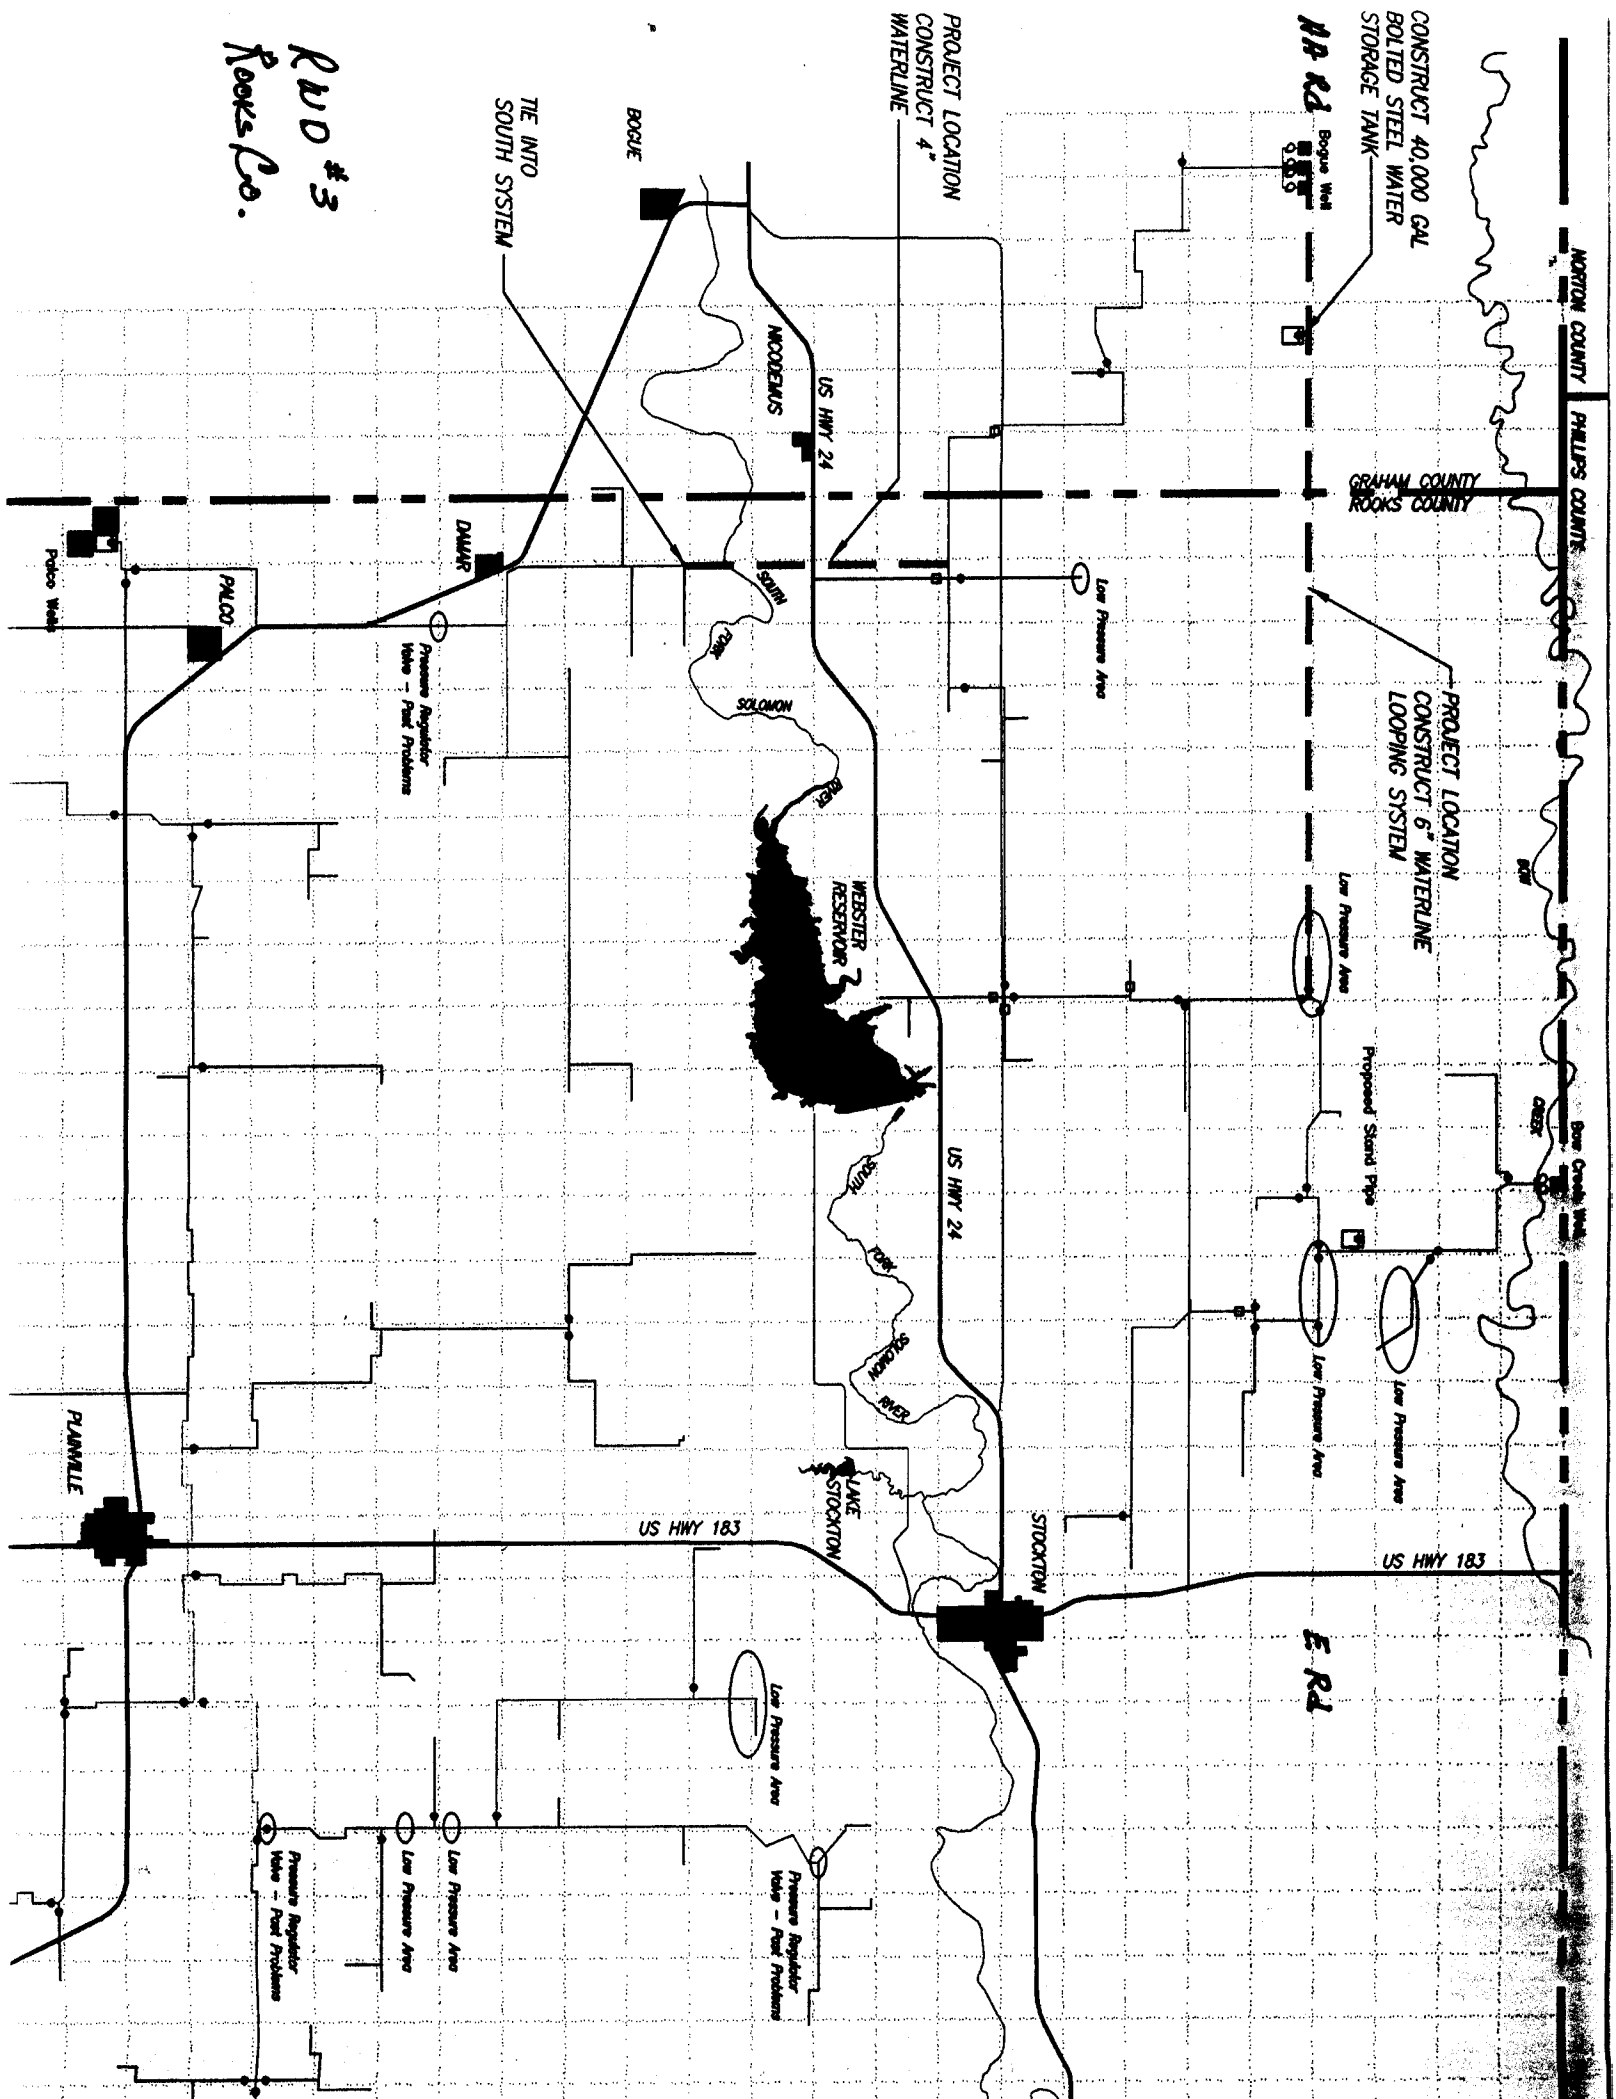

**PROJECT LOCATION
CONSTRUCT 6" WATERLINE
LOOPING SYSTEM**

